



Vertical Cable Manager (AR7580A) Installation

Inventory

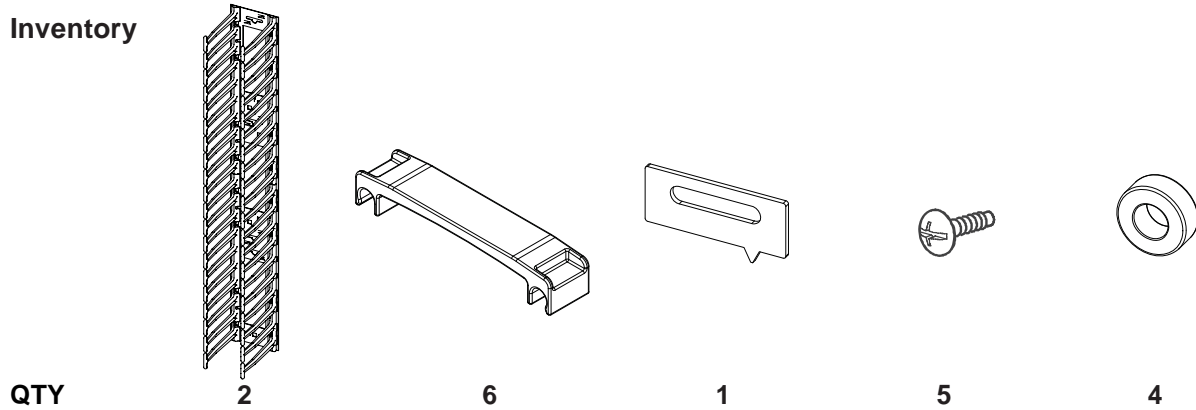


Adjust the vertical mounting rails and remove all hole covers and plugs


Note: If installing in rear of enclosure, move or remove vertical O U accessory channel.

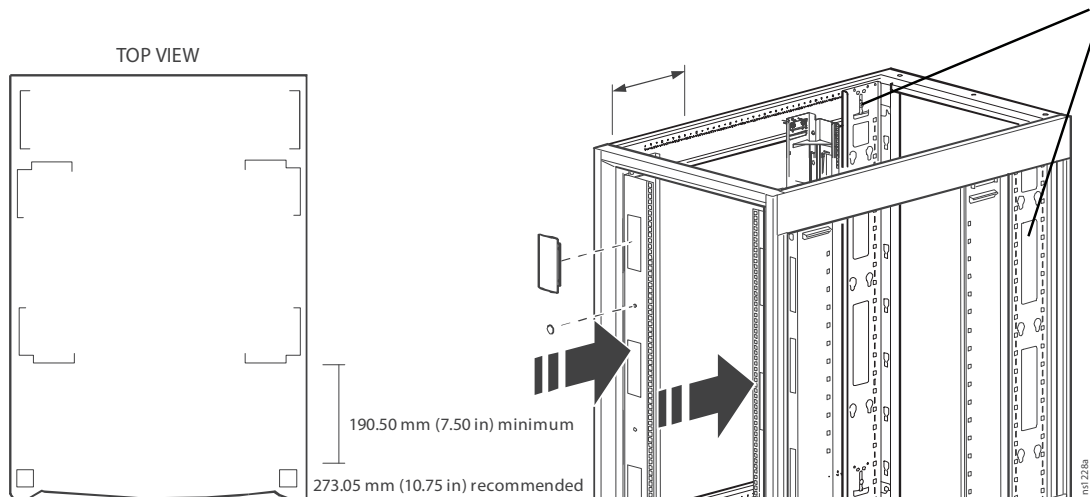

Identify the mounting slots

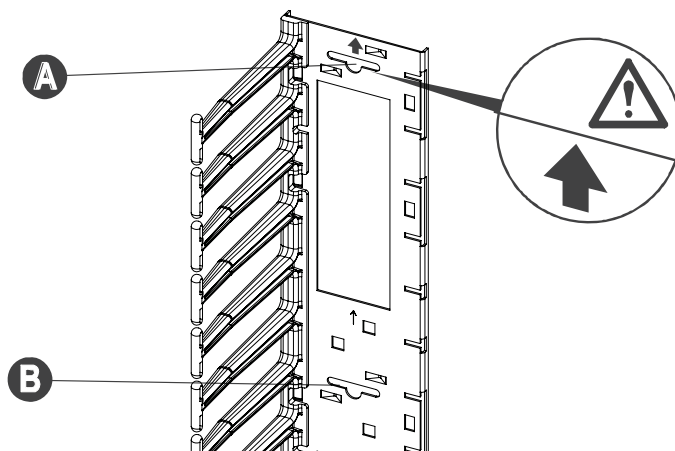


NetShelter 42 U Installation

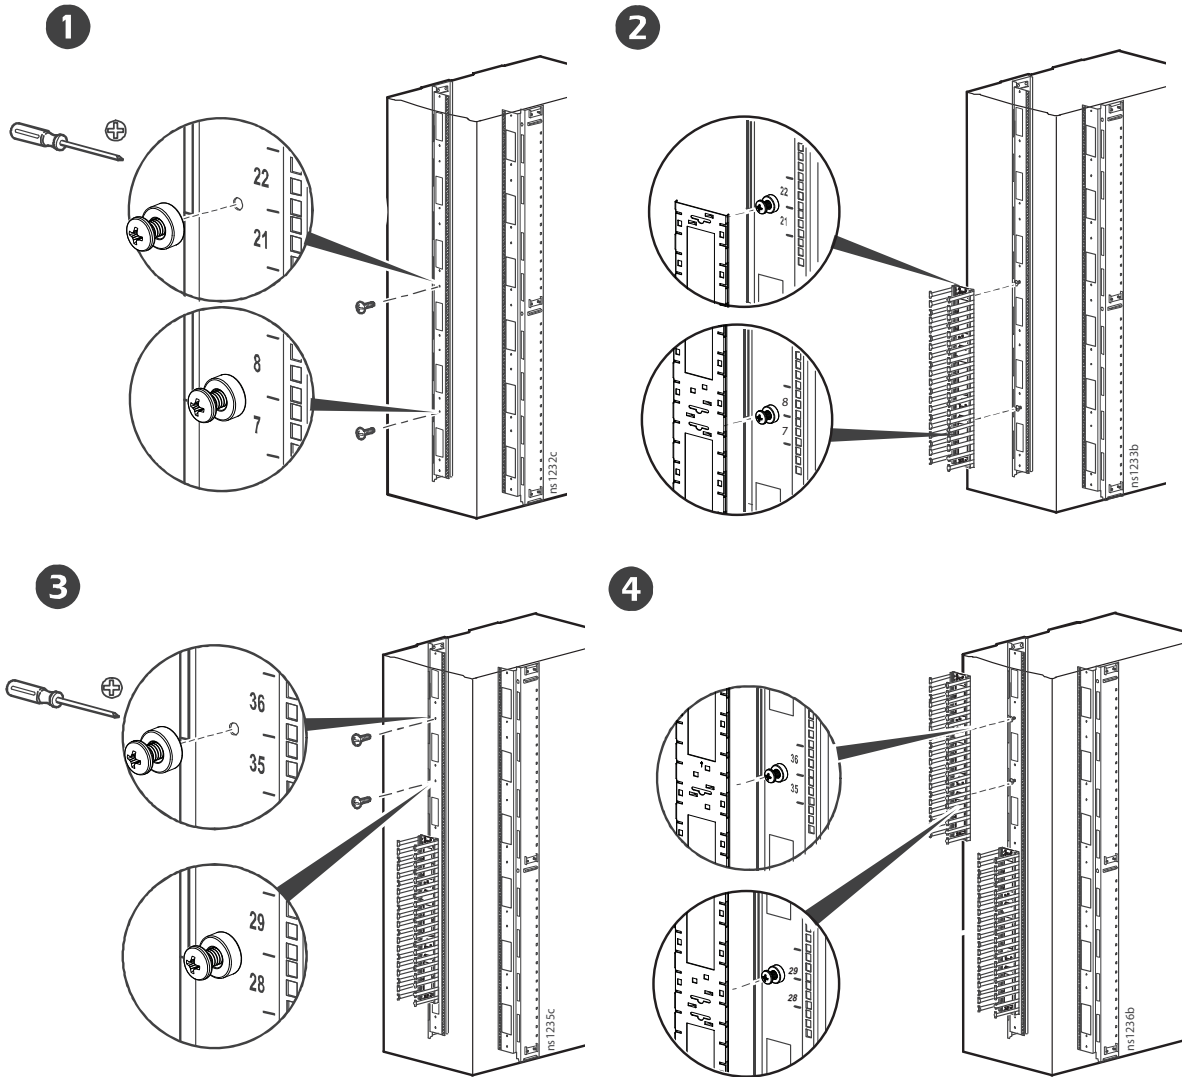

Vertical Cable Manager—Installation

Attach the cable retainers

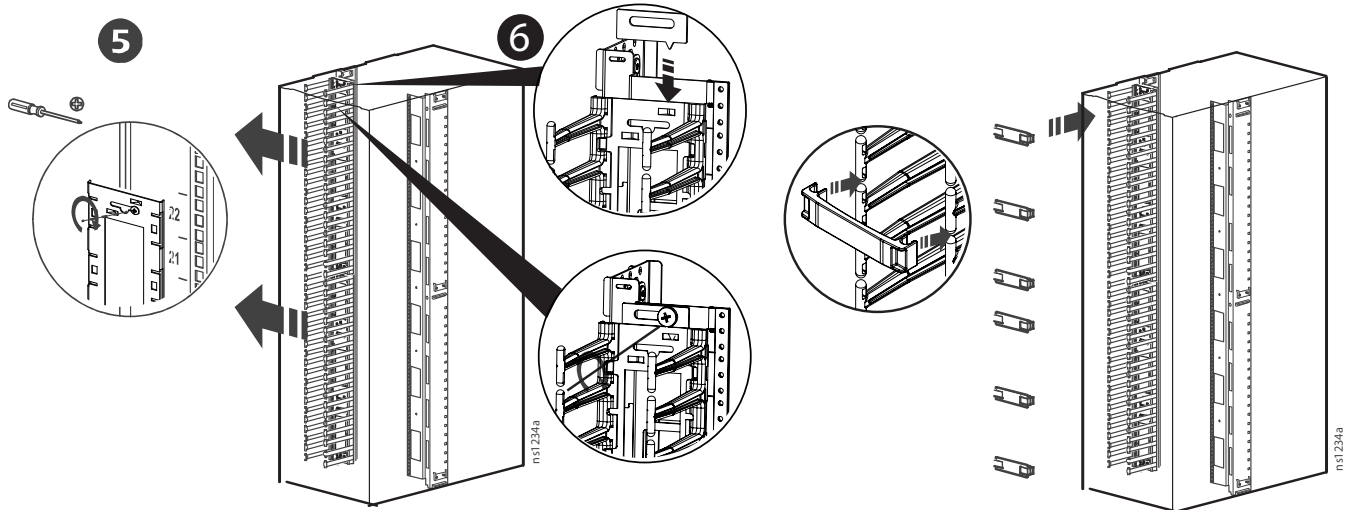

Customer support and warranty information is available at the APC Web site, www.apc.com.

© 2012 APC by Schneider Electric. APC, the APC logo are owned by Schneider Electric Industries S.A.S.
All other trademarks are property of their respective owners.

990-3315A-001
11/2012